


LEGEND

SYMBOL	DESCRIPTION	HEIGHT
	U.P.S. POWER POINT	IN SIDE OF WORK STATION
	3No. 5Amp. SOCKET & SWITCH RAW POWER POINT	IN SIDE OF WORK STATION
	2No. 5Amp. SOCKET & SWITCH	IN SIDE OF WORK STATION
	NETWORKING POINT (CAT-6 WIRE)	IN SIDE OF WORK STATION
	TELEPHONE POINT	IN SIDE OF WORK STATION
	NETWORKING SWITCH	6'6" HT
	E.P.B.X	6'6" HT
	RAW POWER D.B.	6'6" HT
	U.P.S. POWER D.B.	6'6" HT
	U.P.S. PRIMARY & SECONDARY SWITCH & SOCKET	4'6" HT
	CEILING FAN	ON CEILING
	40WX4'0" TUBE LIGHT FITTING	8'6"
	1X18W / 1X23W C.F.L	8'6"
	CEILING LIGHT	ON CEILING
	SWITCH BOARD WITH 5AMP SOCKETS	4'6" HT
	SWITCH BOARD WITHOUT 5AMP SOCKETS	4'6" HT
	2X2 LED. LIGHT CEILING	ON CEILING
	EXHAUST FAN (IN TOI & KIT)	1'6" HT
	DISTRIBUTION BOARD	6'6" HT
	L.T MAIN CONTROL PANEL	+1'6" HT
	WALL- FAN	5'6" HT

	ROUTE OF UPS. POWER WRING.(25MM)
	ROUTE OF RAW POWER WRING.(25MM)
	ROUTE OF POINT WRING (19MM)
	ROUTE OF POINT WRING (25MM)
	ROUTE OF CIRCUIT WRING (25MM)
	ROUTE OF SUBMAIN WRING (25MM)
	ROUTE OF POWER POINT WRING.(25MM)
	ROUTE OF AC. POINT WRING.(25MM)
	ROUTE OF TELEPHONE WRING
	ROUTE OF DATA CABLE WRING

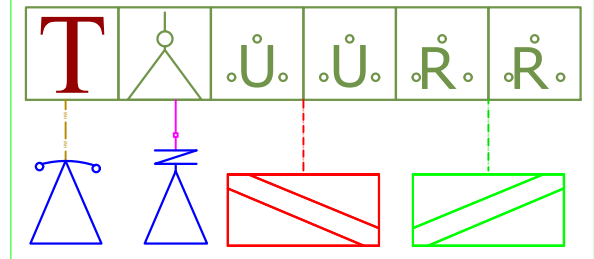

DISTRIBUTION BOARD DETAILS- COMPUTER UPS POWER D.B's.-1

2+8 WAY'S MCB TYPE DOUBLE DOOR DISTRIBUTION BOARD						
MCB	CIRCUIT	AMPS.	NOS.	VOLTS.	NOS. OF WIRES	COLOUR CODE OF WIRES
S.P.N *C-10Ka	SUB-MAIN UPS POWER POINT CIRCUIT	32A	01	220V	2X6SQ. MM(LOAD) +1X6SQ. MM(EARTH)	RED+BLACK(LOAD) & GREEN (EARTH)
S.P *C-10Ka	POWER	6A/10A	08	220V	2X2.5SQ. MM(LOAD) +1X2.5SQ. MM(EARTH)	RED+BLACK(LOAD) & GREEN (EARTH)

DISTRIBUTION BOARD DETAILS- COMPUTER RAW POWER D.B's.-1

2+8 WAY'S MCB TYPE DOUBLE DOOR DISTRIBUTION BOARD						
MCB	CIRCUIT	AMPS.	NOS.	VOLTS.	NOS. OF WIRES	COLOUR CODE OF WIRES
S.P.N *C-10Ka	SUB-MAIN UPS POWER POINT CIRCUIT	32A	01	220V	2X6SQ. MM(LOAD) +1X6SQ. MM(EARTH)	RED+BLACK(LOAD) & GREEN (EARTH)
S.P *C-10Ka	POWER	6A/10A	8	220V	2X2.5SQ. MM(LOAD) +1X2.5SQ. MM(EARTH)	RED+BLACK(LOAD) & GREEN (EARTH)

DISTRIBUTION BOARD DETAILS- COMPUTER RAW POWER D.B's.-1

2+12 WAY'S MCB TYPE DOUBLE DOOR DISTRIBUTION BOARD						
MCB	CIRCUIT	AMPS.	NOS.	VOLTS.	NOS. OF WIRES	COLOUR CODE OF WIRES
S.P.N *C-10Ka	SUB-MAIN UPS POWER POINT CIRCUIT	32A	01	220V	2X6SQ. MM(LOAD) +1X6SQ. MM(EARTH)	RED+BLACK(LOAD) & GREEN (EARTH)
S.P *C-10Ka	POWER	6A/10A	8	220V	2X2.5SQ. MM(LOAD) +1X2.5SQ. MM(EARTH)	RED+BLACK(LOAD) & GREEN (EARTH)

Drawing Title:- CANARA BANK SIRMATPUR BRANCH ELECTRICAL LAYOUT PLAN	NORTH :		REVISIONS:
	Client : CANARA BANK		Checked by: ER. K.G. PRASAD
Architects : ATTIK ARCHITECTS architect SITHLA ASTHAN ROAD, NEAR TILKAMANJHI THANA, BHAGALPUR ,PH. NO. 7503821328 9430546484, 9899677289	Draft by: RAHUL KR.	Date:- 28-06-2025	Notes :
Consultants : KRISHNA GOPAL PRASAD(B.E.ELECTRIC) ELECTRICAL CONSULTANT (EMAIL:-kgprasad62@gmail.com) COMPUTER AIDED ELECTRICAL DESIGNER 402, SUN RISE KAMLA-REKHA SHREE, RAJ RAM BRIKSH PATH, NEHRU NAGER PATLIPUTRA COLONY, PATNA (BIHAR) PIN CODE-800013. PHONE NO.-9431066089	ATTIK ARCHITECTS This drawing/design is property of Attik architects. No part of this may be reproduced or implemented in any form without prior permission in writing from Architects. Any person doing so, shall be liable to criminal prosecution and civil claims for damages.		

ALL DIMENSIONS ARE TO BE CHECKED AND CO-RELATED WITH THE RELEVANT ARCHITECTURAL & STRUCTURAL DRAWINGS AND ANY AMBIGUITY SHALL BE IMMEDIATELY BROUGHT TO THE NOTICE OF THE ARCHITECTS BEFORE COMMENCEMENT OF THE WORK. THIS DRAWING IS THE PROPERTY OF ATTIK ARCHITECTS AND IS NOT TO BE COPIED OR USED WITHOUT THEIR PERMISSION.